

1810 E. HAZELTON AVE., STOCKTON, CA 95205-8232 PHONE: 209/468-3121 FAX: 209/468-3163

Liquefied Petroleum Gas

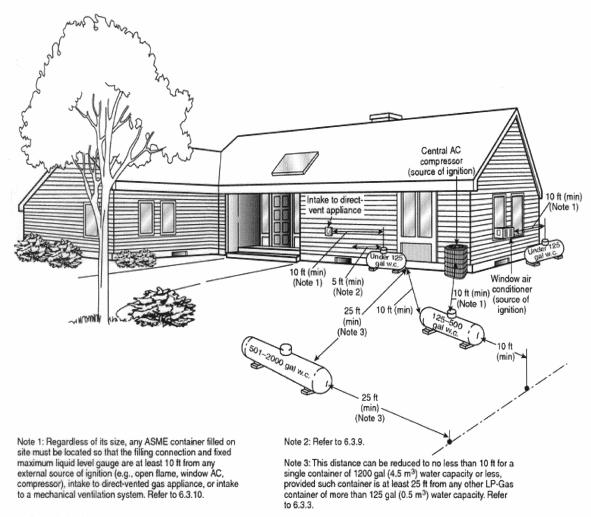


FIGURE I.1(b) Aboveground ASME Containers. (This figure for illustrative purposes only; code shall govern.)

Weeds, Brush, Combustible Vegetation, and any other debris that may be considered a fire hazard shall be removed within a 10 ft diameter around the tank. (dispensing tanks and surrounding areas with the hose fully extended).

Protection from Vehicles. Guard posts or other approved means shall be provided to protect storage tanks and connected piping, valves and fittings; dispensing areas; and use areas subject to vehicular damage. When guard posts are required to be installed, the posts shall be:

- 1. Constructed of steel not less than 4 inches in diameter and concrete filled.
- 2. Spaced not more than 4ft. between posts on center.
- 3. Set no less than <u>3 ft deep</u> in a concrete footing of not less than <u>15 inches in diameter</u>.
- 4. Set with the top of the posts not less than 3 ft above ground.
- 5. Located not less than 3 ft from the tank.